



■ Line Voltage Passive Infrared Sensor



BRI810-B-M8




RC-100
(OPTIONAL)

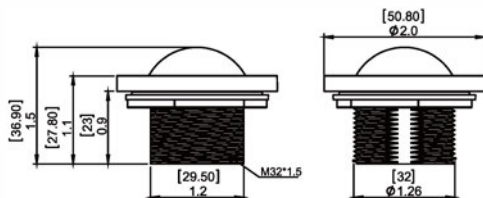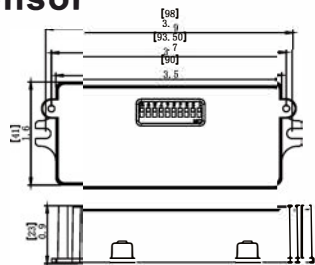

SPECIFICATIONS

Power supply	120/277VAC 50/60Hz
Maximum load @ -40°F ~ +158°F (-40°C ~ +70°C)	Resistive/Tungsten - 600W@120V Electronic Ballast (LED) - 800VA@120V/1200VA@277V
Dim control output	0-10V max. 25mA sinking current
Detection radius/angle	Max 26ft.(8m) /360°
Mounting height	Max 40ft
Humidity	Max. 95% RH
Temperature	-40°F ~ +158°F (-40°C ~ +70°C)

SENSOR COVERAGE

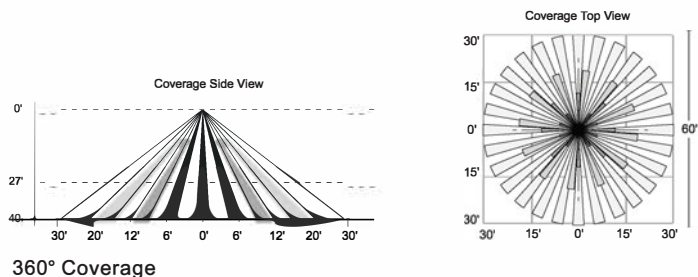

⚠ WARNING

NOTE: Warm up time is 40seconds. After the sensor connects input power, the light will keep on 40seconds, then go to dimming to work normally.

NOTE: Factory Default Setting: 100% sensitivity, Hold on time: 10seconds, Daylight sensor is 30lux, Dimming level: 30%, Dimming time: 60minutues.

NOTE: Any setting changed by DIP Switch or remote control, the light that sensor connect will on/off as confirm.

UTILIZING FIELD AND INTRODUCTION

The BRI810-B-M8 is Passive infrared occupancy sensor, as a fixture sensors mounts in indoor light fixture and provides Bi-level control. It works by 120~277Vac power, and controls 0-10VDC LED drivers or dimming ballasts All controls parameters (Hold time, daylight sensor threshold, stand-by level, stand-by time) are adjustable via dip switch.


FUNCTION AND OPTIONS

The Passive infrared occupancy sensor to achieve tri-level dimming control, for some areas that require a light change notice before switch off.


It offers 3 levels of the light Control : 100%--dimming light (0,10%,30%,50%)--off; and 2 periods of selectable waiting time: motion hold-time and stand-by time. Selectable daylight threshold and choice of detection area.



With sufficient natural light, the light does not switch on when presence detected.



With insufficient natural light, the sensor switches on the light automatically when person enters room.




People left, light still dims to 0/10%/30%/50% (options) standby level after the hold time.



Light switches off automatically after after stand-by time elapsed.

PARAMETER SETTING BY DIP SWITCH


Consider the picture: 1, 2 set sensitivity; 3, 4 set hold time; 5, 6 set the lux; 7, 8 stand-by light level ; 9, 10 set stand-by time ;





Detection Range Setting (sensitivity)

Detection range can be reduced by selecting the combination on the DIP switches to fit precisely each application:




SENSITIVITY	
1	2
↓ ↓	20%
↓ ↑	50%
↑ ↓	75%
↑ ↑	100%

Hold Time Setting

The lamp can be set to stay ON for any period of time between approx. 10sec and a maximum of 15min. Any movement detected before this time elapse will re-start the timer. It is recommended to select the shortest time for adjusting the detection zone and for performing the walk test.


Switch location and hold time of the corresponding table is as follows:



TIME	
3	4
↓ ↓	10S
↓ ↑	1Min
↑ ↓	5Min
↑ ↑	15Min

Light-control Setting

The chosen lamp response threshold can be infinitely from approx. 10-50lux, switch location and light-control of the corresponding table is as follows:



LIGHT	
5	6
↓ ↓	☀ (light sensor disable)
↓ ↑	10Lux
↑ ↓	30Lux
↑ ↑	50Lux

Stand-by Light Level Setting


The corresponding file of switch location and Stand-by Level as follow:



STAND-BY LEVEL	
7	8
↓ ↓	0%
↓ ↑	10%
↑ ↓	30%
↑ ↑	50%

Stand-by Time Setting

File of switch location and stand-by time setting as follow:






STAND-BY TIME: 9, 10

STAND-BY TIME

9	10	
↓	↓	+∞
↓	↑	1Min
↑	↓	30Min
↑	↑	60Min


PARAMETER SETTING BY REMOTE CONTROL IN MANUAL OF RC-100.

INSTALLATION

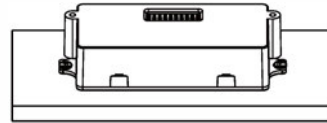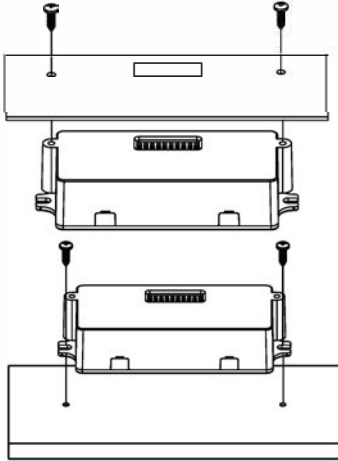

WIRING DIAGRAMS

Wiring with dimming ballast or LED driver.
Dimming Driver

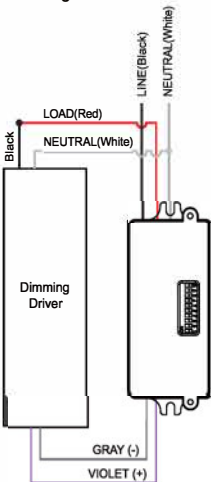

Wiring with non-dimming ballast or LED driver.
Non-Dimming Driver

